
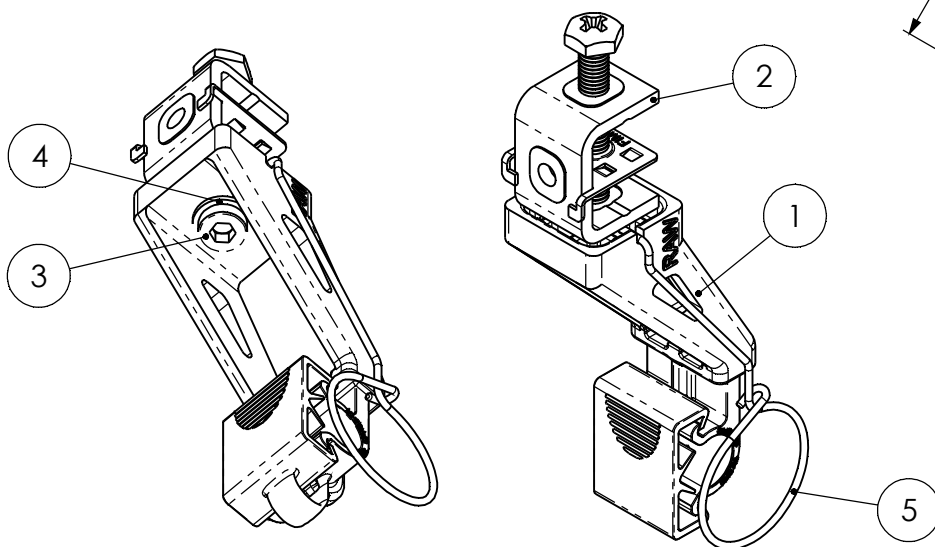


# PRODUCT DATA SHEET

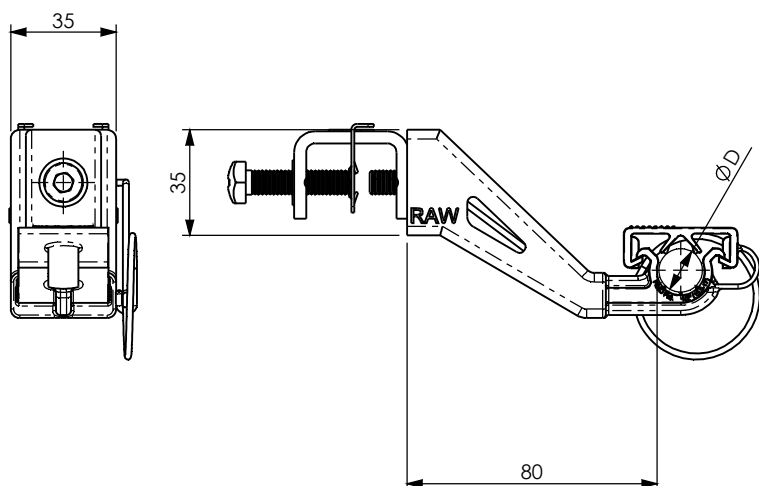

## A) SPECIFICATIONS

- 1 Cable clamp. Material: PA6-VO, black colour, self extinguishing, halogen free (according to UL94-VO).
- 2 Stainless steel MIM8/25=mini clamp M8
- 3 Stainless steel VCI M8x25
- 4 Stainless steel RPI 8/16 flat washer
- 5 AISI 316 RSD safety clamp

## B) OPERATING TEMPERATURE


Working temperature : -40°C +125°C.  
Installation temperature : -20°C +60°C.

## C) DELIVERY MODALITIES

Packing in boxes. Label indicating: product code, article, quantity, production batch, FIMO logo and figure. ( Customer code on request ).

## D) MOUNTING INSTRUCTIONS

On request

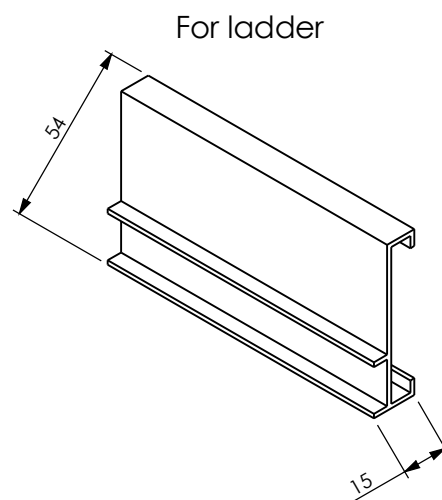

|         |                                                 |
|---------|-------------------------------------------------|
| code    | <b>6150210012.25</b>                            |
| article | KIT RAW 1/2"-80 M8 + RSD 1/2"-7/8"_80 + MIM8/25 |

|          |    |          |
|----------|----|----------|
| <b>D</b> |    |          |
| 15.5-17  | 50 | 0.1482kg |

| RI                                                                                 | DATE       | DR   | DATE       | AP                                                                                  | Description:<br><br><b>KIT RAW 1/2"-80 M8 + RSD 1/2"-7/8"_80 + MIM8/25<br/>Radiating Cable Clamp</b> |
|------------------------------------------------------------------------------------|------------|------|------------|-------------------------------------------------------------------------------------|------------------------------------------------------------------------------------------------------|
| 02                                                                                 |            |      |            |                                                                                     |                                                                                                      |
| 01                                                                                 | 23/09/2016 | E.B. | 23/09/2016 | A.V.                                                                                |                                                                                                      |
| 00                                                                                 | 20/07/2016 | E.B. | 20/07/2016 | A.V.                                                                                |                                                                                                      |
| 1 <sup>ST</sup> EMISSION                                                           |            |      |            |                                                                                     |                                                                                                      |
|  |            |      |            |  | Use: <i>Installation of radiating cables in tunnel</i>                                               |